


636

REVISED 4/03

PREFERRED GROUNDING CONFIGURATION WHEN A BUILDING HAS A METALLIC WATER PIPE SERVICE

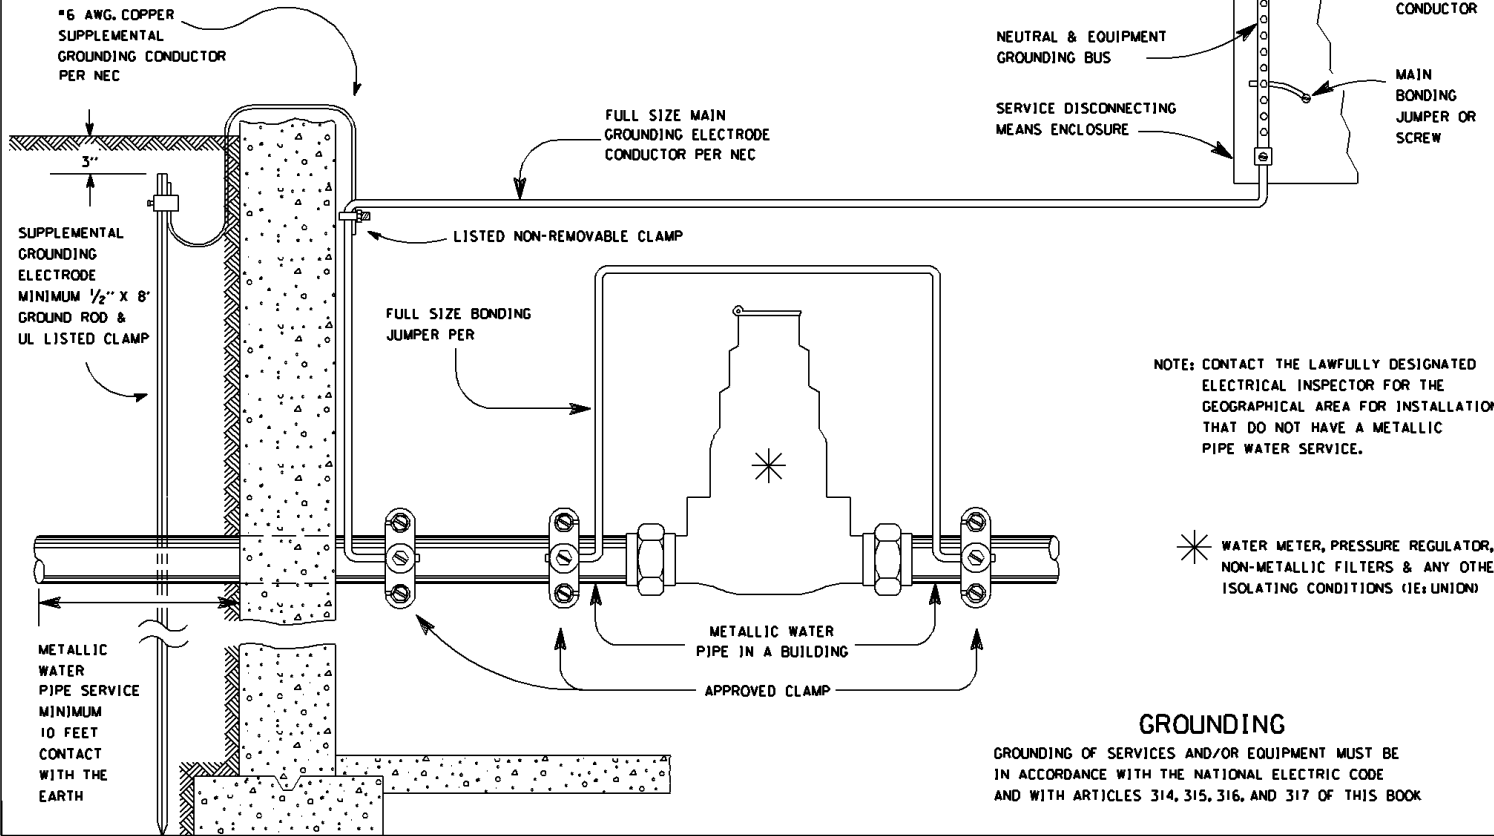

GROUNDING

GROUNDING OF SERVICES AND/OR EQUIPMENT MUST BE IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE AND WITH ARTICLES 314, 315, 316, AND 317 OF THIS BOOK