

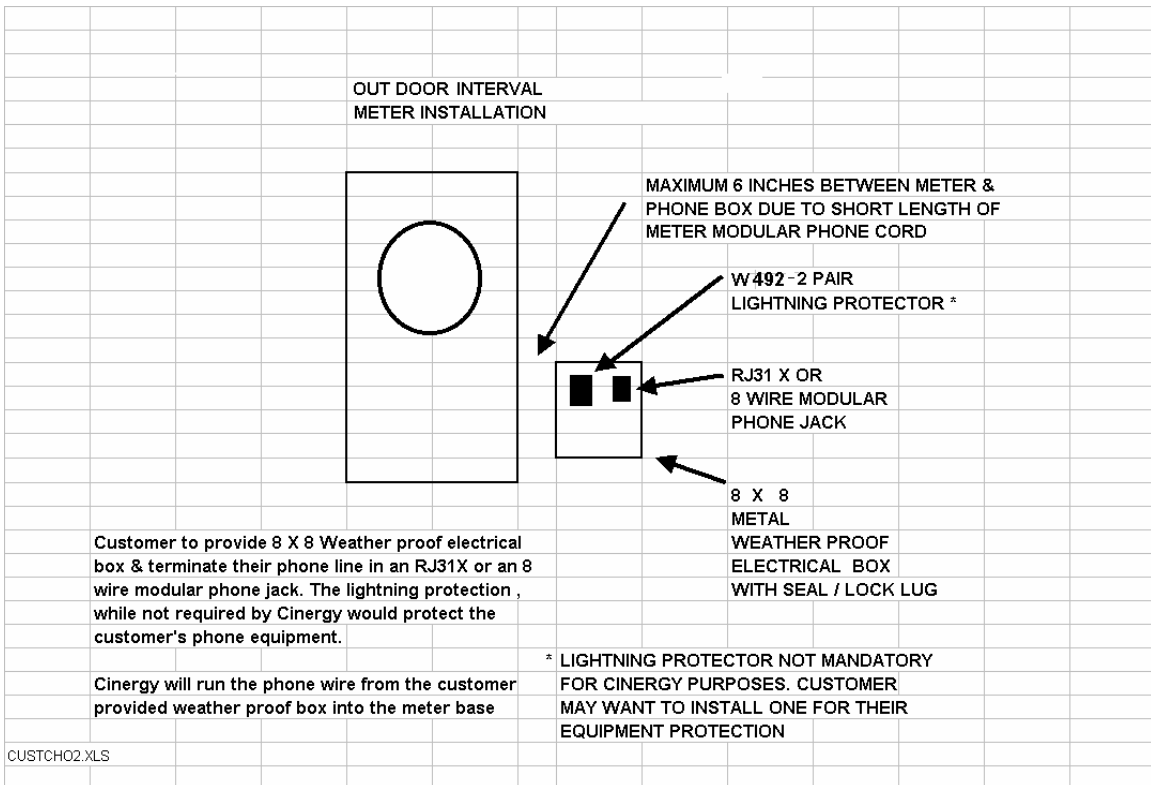


CUSTOMER CHOICE PHONE LINE REQUIREMENTS

The attached drawings show the phone line requirements for Customer Choice metering. The outdoor metal weather proof electrical box must have sealing provisions to allow a seal or lock. The outdoor metal weather proof electrical box (8" X 8" minimum) is available from most Electrical suppliers. The seal and/or lock is to secure the customer's phone line from tamper.

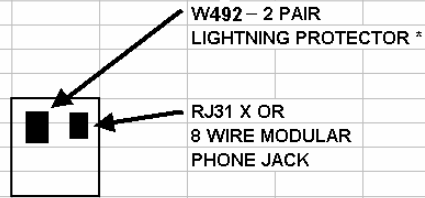

METAL - OUTDOOR METER CABINET

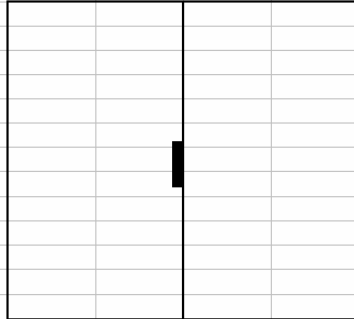

8 X 8
METAL
WEATHER PROOF
ELECTRICAL BOX
WITH SEAL / LOCK LUG



Customer to provide 8 X 8 Weather proof electrical box & terminate their phone line in an RJ31X or an 8 wire modular phone jack. The lightning protection, while not required by Cinergy would protect the customer's phone equipment.

Cinergy will run the phone wire from the customer provided weather proof box into the meter cabinet.

* LIGHTNING PROTECTOR NOT MANDATORY FOR CINERGY PURPOSES. CUSTOMER MAY WANT TO INSTALL ONE FOR THEIR EQUIPMENT PROTECTION

CUSTCH01.XLS

**INDOOR INTERVAL
METER INSTALLATION**

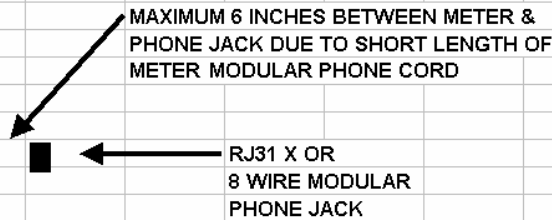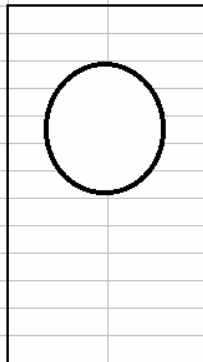

CUSTOMER'S PHONE JACK SHOULD BE MOUNTED JUST ABOVE THE CENTER OF THE METER BASE. THIS IS BECAUSE OF THE SHORTNESS OF THE MODULAR PHONE CORD PROVIDED BY THE METER MANUFACTURER

CINERGY WILL RUN THE PHONEWIRE FROM THE PHONE JACK TO THE METER

CUSTCH03.XLS