


602

REVISED 4/07

TYPICAL INSTALLATION USING PAD MOUNTED TRANSFORMER

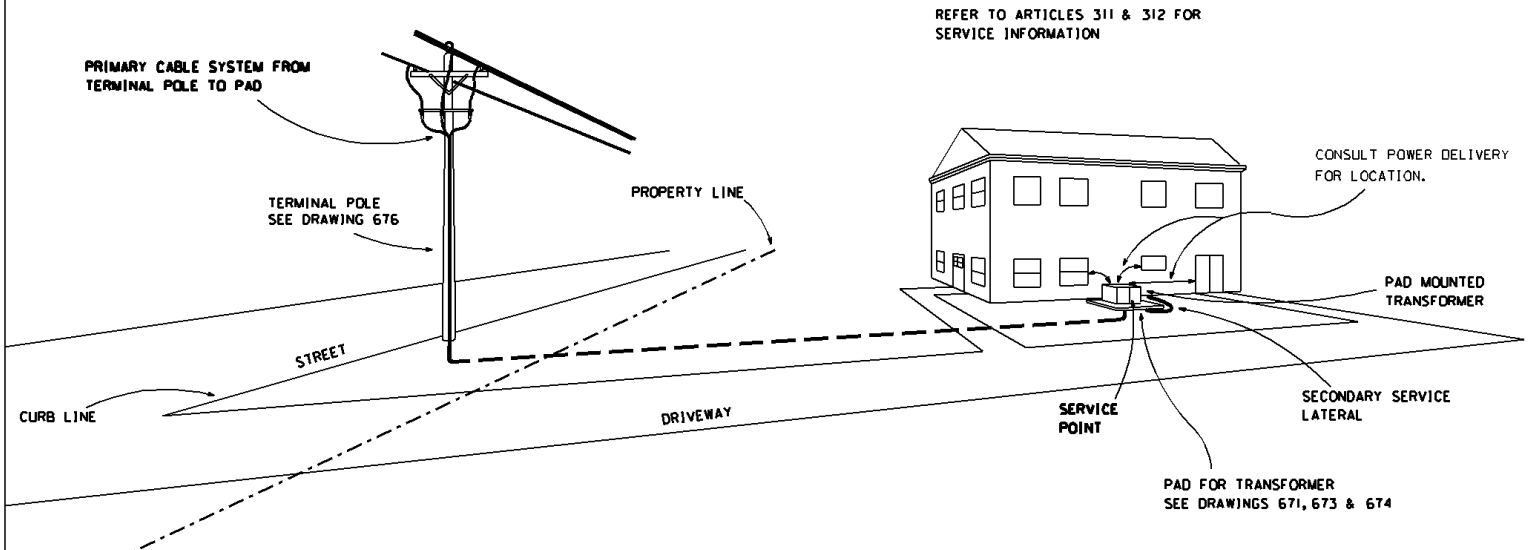

CONTACT POWER DELIVERY FOR THE LOCATION, SIZE, CONSTRUCTION DETAILS AND VEHICULAR PROTECTION REQUIRED WHEN INSTALLING A PAD FOR A PADMOUNT TRANSFORMER. REFER TO DRAWINGS 670, 671, 672, 673, 674 & 675

* PLEASE NOTE: THERE ARE CLERANCE REQUIREMENTS FOR THE TRANSFORMER LOCATION FROM DOORS, WINDOWS, ETC. PLEASE CONSULT WITH POWER DELIVER FOR EXACT CLERANCES.