


# TERMINATING UNDERGROUND SERVICE LATERAL CONDUCTORS ( 600 VOLTS OR LESS )

SEE ARTICLES  
311 AND 312 ON  
UNDERGROUND SERVICE  
LATERALS


## OUTDOOR METER INSTALLATION

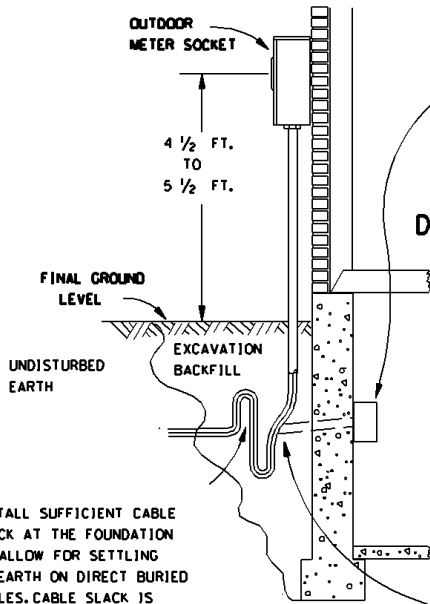

INSTALL SUFFICIENT CABLE SLACK AT THE FOUNDATION TO ALLOW FOR SETTLING OF EARTH ON DIRECT BURIED CABLES. CABLE SLACK IS REQUIRED TO REDUCE HEAVY TENSIONS ON THE INSULATED BLOCKS OF THE METER SOCKET JAWS.


FOR AN INDDOR METER INSTALLATION, THE UNDERGROUND SERVICE RACEWAY MAY PASS THROUGH THE WALL AND TERMINATE AT A SERVICE-ENTRANCE BOX (SEE DETAIL BELOW).

## DETAIL OF CONDUIT THROUGH A WALL

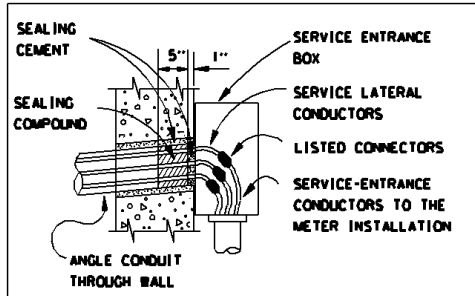

FOR CLEARANCES TO BE MAINTAINED WITH GAS LINE AND OTHER UTILITIES, CONSULT THE UTILITY INVOLVED.

## \* INDOOR METER INSTALLATION

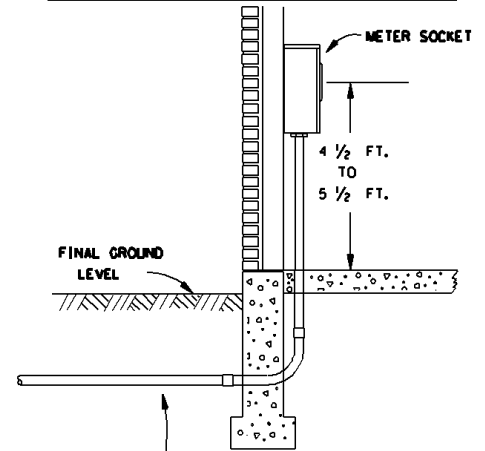

\* AN INDOOR LOCATION OF A METER SOCKET IS NOT PERMITTED ON NEW INSTALLATION UNLESS MANDATED BY A COMMUNITY ORDINANCE.

THE INSTALLATION REQUIREMENTS & APPROVAL OF THE SERVICE LATERAL (DEPTH, AMPACITY, TYPE, ETC.) ARE UNDER THE JURISDICTION OF THE LAWFULLY-DESIGNATED ELECTRICAL INSPECTOR FOR THE GEOGRAPHICAL AREA.