
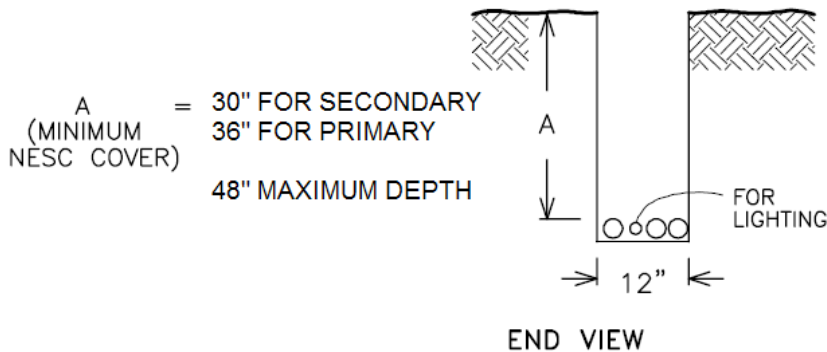


STREET CROSSING SPECIFICATIONS

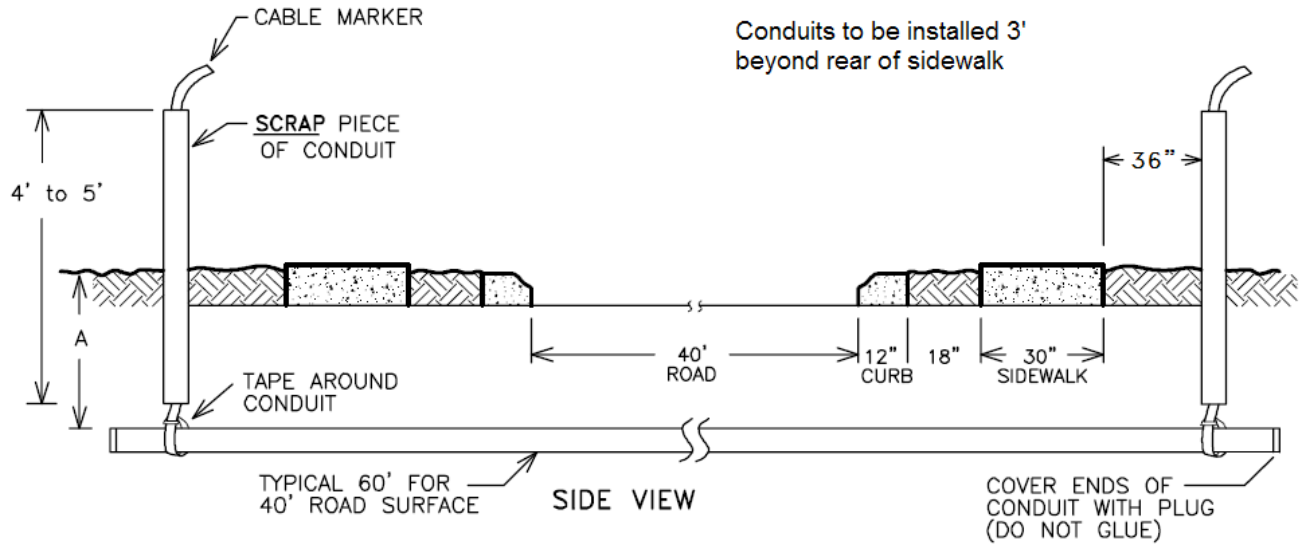

Conduit Under Road - Detail

**** Gray PVC electrical style conduit shall be used ****
 Conduit size will be specified by Duke Energy.

NOTES:

1. Install size(s), quantity, and at locations as specified by Duke Energy
2. Tamp for appropriate compaction
3. If possible, also identify crossings with an "E" painted on curb